


# SURFACE TYPE METER SOCKET

120/240 VOLT 3-WIRE 320 AMPERE UNDERGROUND SERVICE  
"GENERAL SERVICE ONLY"

4.02.7

M131  
M131D

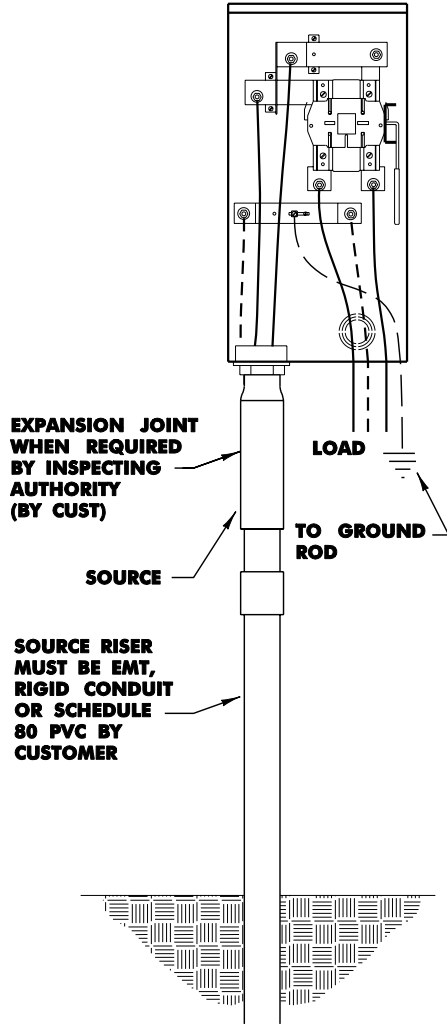


**NOTE:**

A MINIMUM CLEAR WORKING SPACE OF 2.5 FT ABOVE, BELOW, AND NECESSARY SIDE WORKING CLEARANCE, AS WELL AS 36" HORIZONTALLY IN FRONT OF THE METERING, SHALL BE PROVIDED AND MAINTAINED.

A GROUND ROD (NEC SUPPLEMENTAL GROUND) MUST BE INSTALLED NEAR THE METER SOCKET WITH AN EQUIPMENT GROUNDING CONDUCTOR RUNNING FROM THE GROUND ROD TO THE GROUNDING LUG PROVIDED IN THE METER SOCKET.

SOURCE AND LOAD CONDUIT CANNOT BE INTERCHANGED.

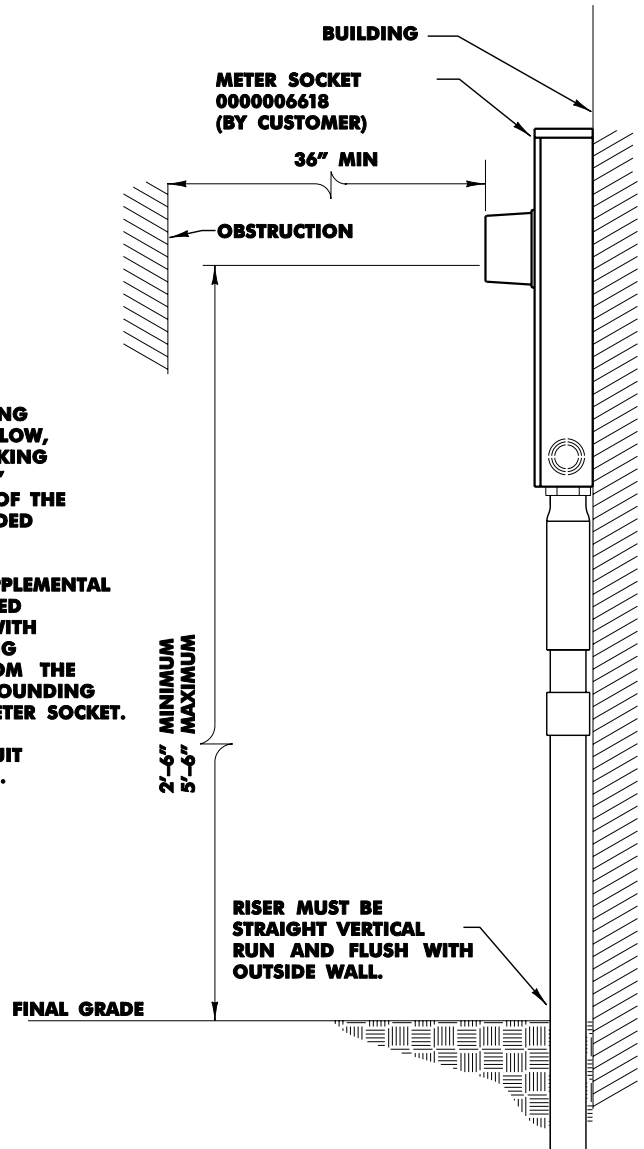

REFER TO DWG: 8.04.2