


FOUR WIRE DELTA METERING

FOR USE WITH CURRENT TRANSFORMERS

4.06.13

RMV ONLY: M520D

FOUR WIRE DELTA COMBINED
BANK TRANSFORMERS
120/240V FROM 1 AND 2
240V 3Ø FROM 1, 2 AND 3

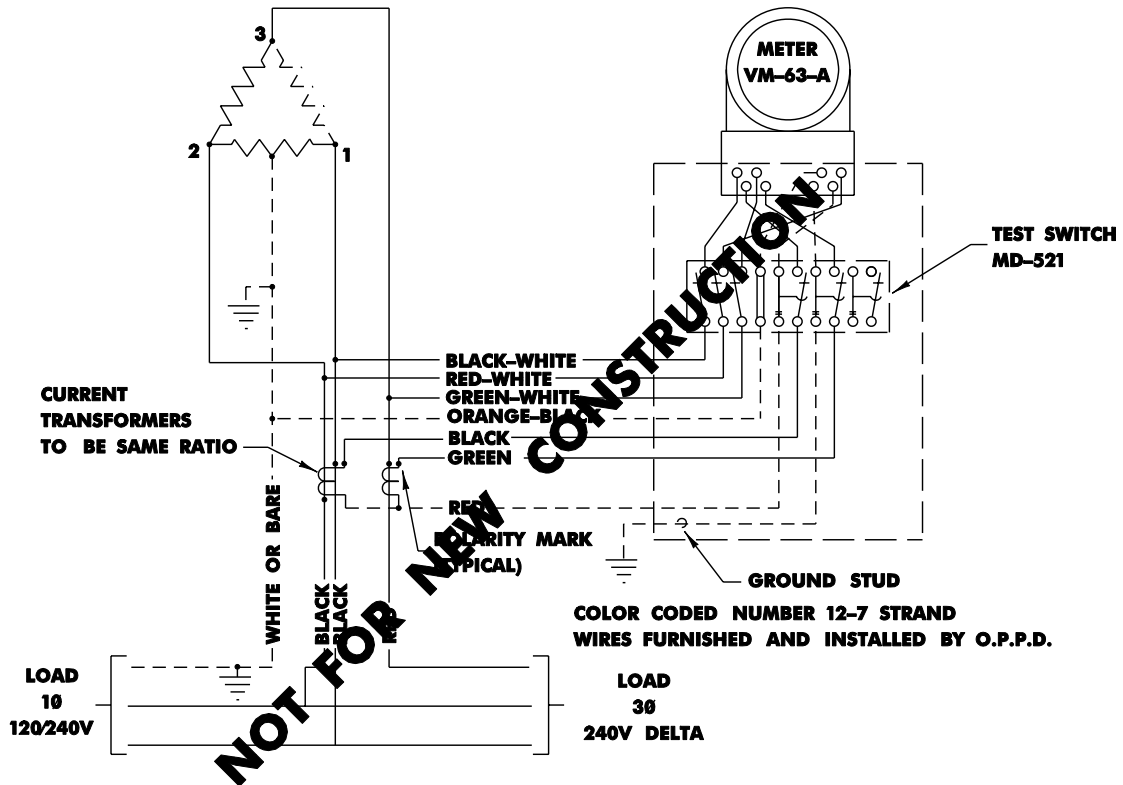

NOTES:

CUSTOMER TO FURNISH AND INSTALL "NATIONAL ELECTRICAL CODE" GRADE STEEL CABINET OF ADEQUATE SIZE FOR THE CURRENT TRANSFORMERS AND ALL WIRING CONNECTIONS

SERVICE ENTRANCE NEUTRAL MUST BE BONDED TO CURRENT TRANSFORMER CABINET

CUSTOMER TO FURNISH AND INSTALL 1" CONDUIT FROM CURRENT TRANSFORMER CABINET TO METER TEST CABINET

FOR LUG CONNECTIONS AN CURRENT TRANSFORMERS UP TO 600 AMPERES MINIMUM BOLT SIZE 3/8" OVER 600 AMPERES MINIMUM BOLT SIZE 1/2"

