


10 PADMOUNT TRANSFORMER SLAB DETAIL

LOW PROFILE-TYPE, 25KVA TO 167KVA

8.08.1

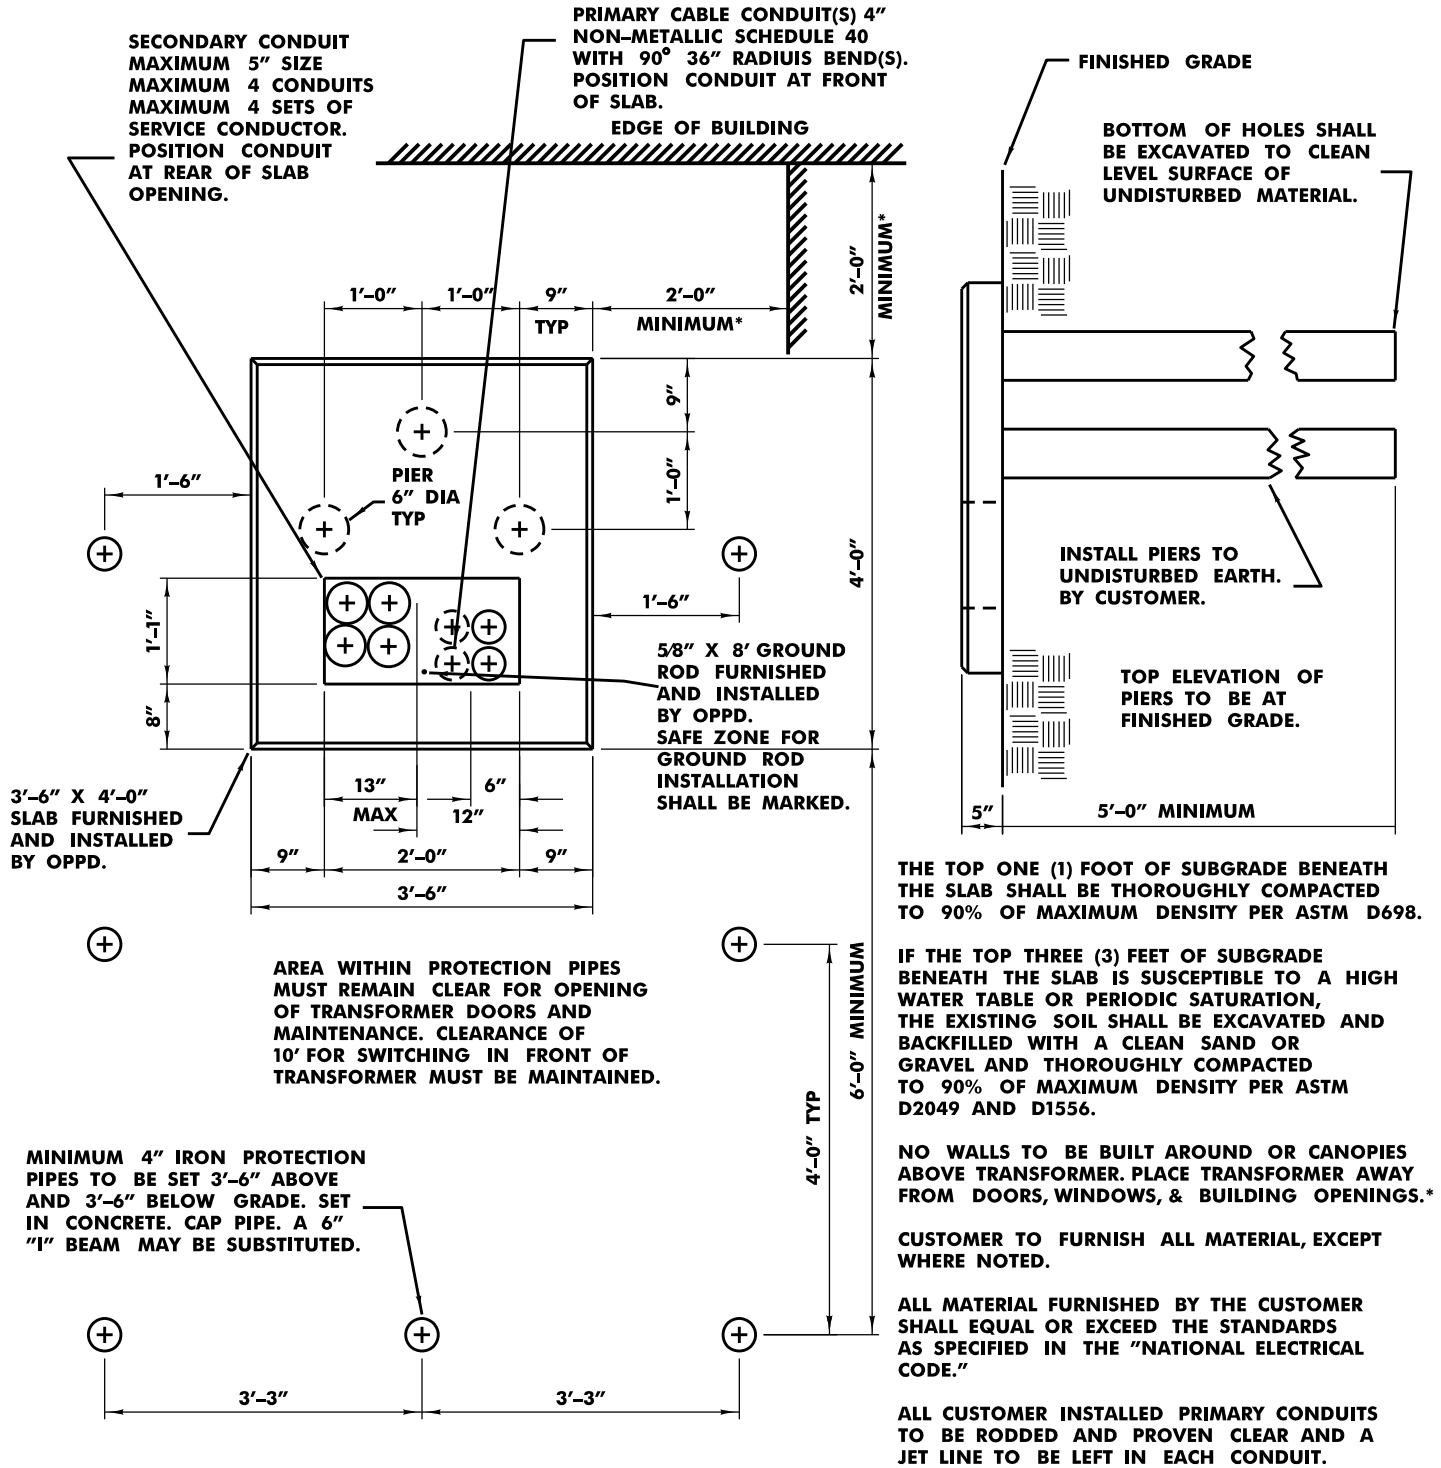

* THIS DRAWING SHOWS THE MINIMUM CLEARANCE NEEDED FOR PHYSICAL REASONS; FACTORY MUTUAL INSURANCE COMPANY RECOMMENDS THE FOLLOWING SEPARATION DISTANCES BETWEEN THE SPECIFIED TYPE OF BUILDING AND TRANSFORMER FOR MINERAL-OIL FILLED TRANSFORMERS WITH UNDER 500 GALLONS OF OIL. BUILDING OWNERS AND THEIR CONTRACTORS ARE RESPONSIBLE FOR LOCATING THE SLAB PER OPPD MINIMUM CLEARANCE GUIDELINES AND THEIR INSURANCE COMPANY RECOMMENDATIONS.

TWO HOURS FIRE RESISTANT CONSTRUCTION	NON-COMBUSTIBLE CONSTRUCTION	COMBUSTIBLE CONSTRUCTION
5'	15'	25'